

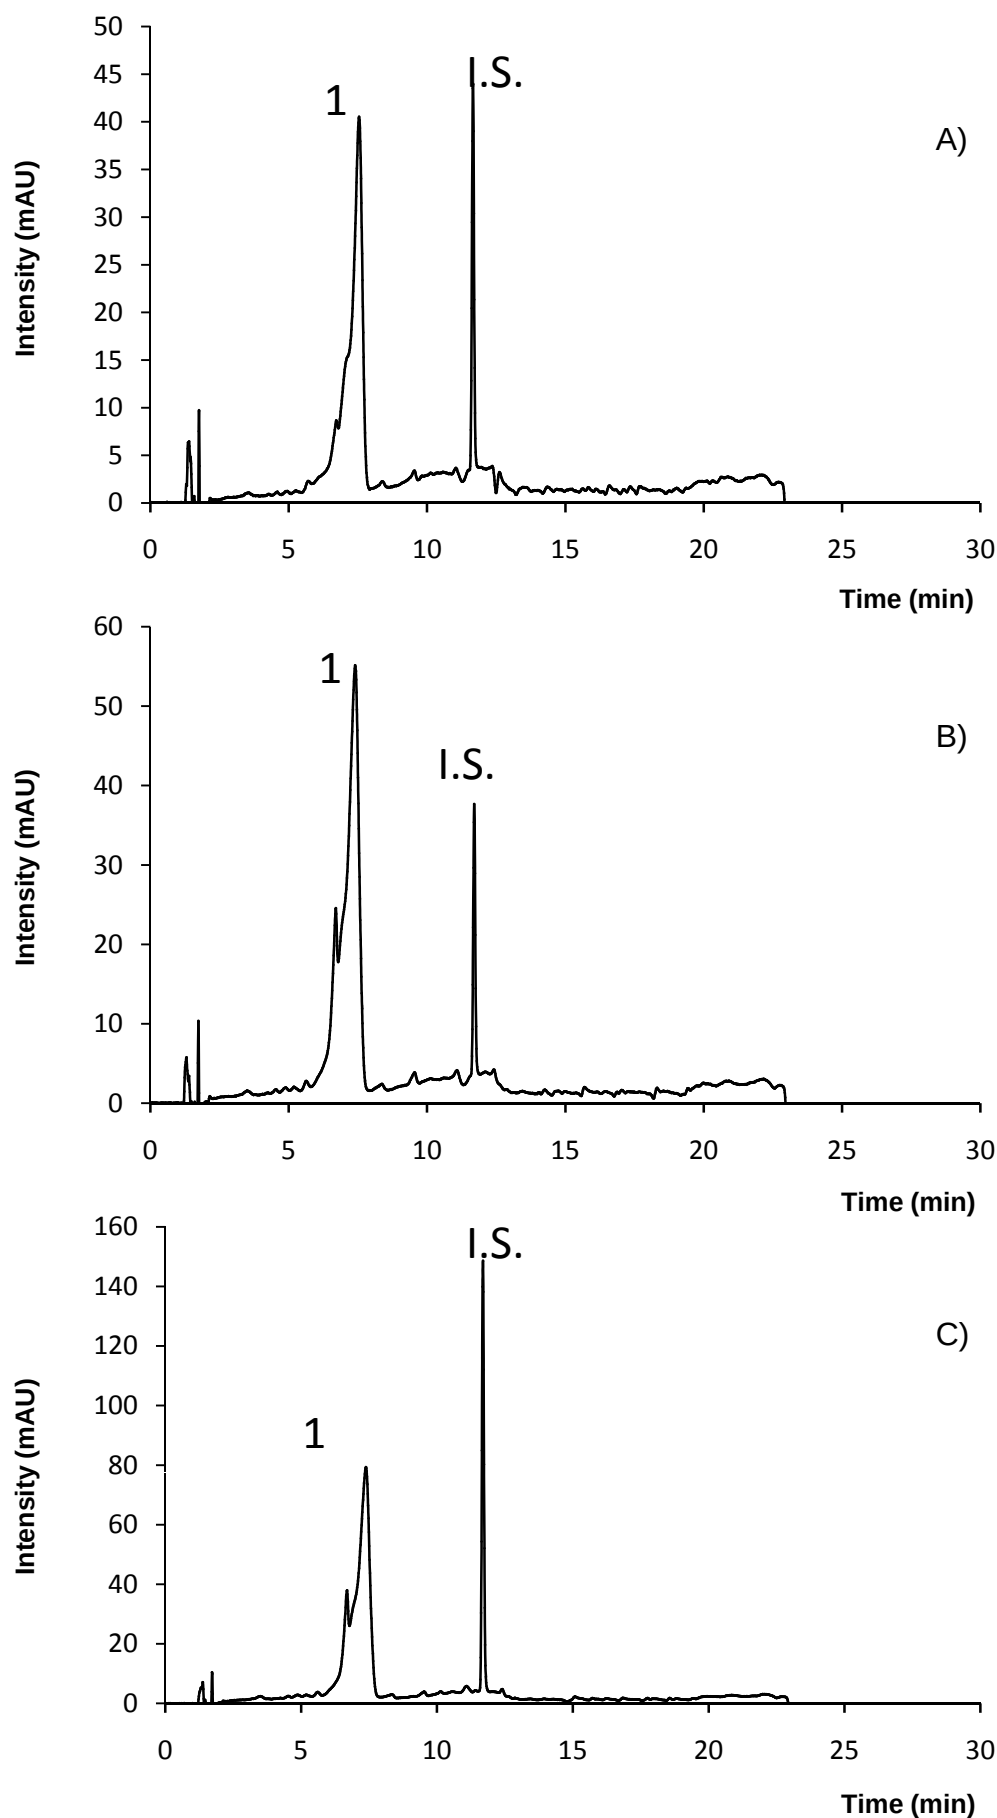


Figure 2 suppl.- Lutein (1) absorption by hdf after irradiation with UVB doses (a, 0 mJ/cm²; b, 100 mJ/cm²; c, 300 mJ/cm²). I.S., internal standard for quantification.