


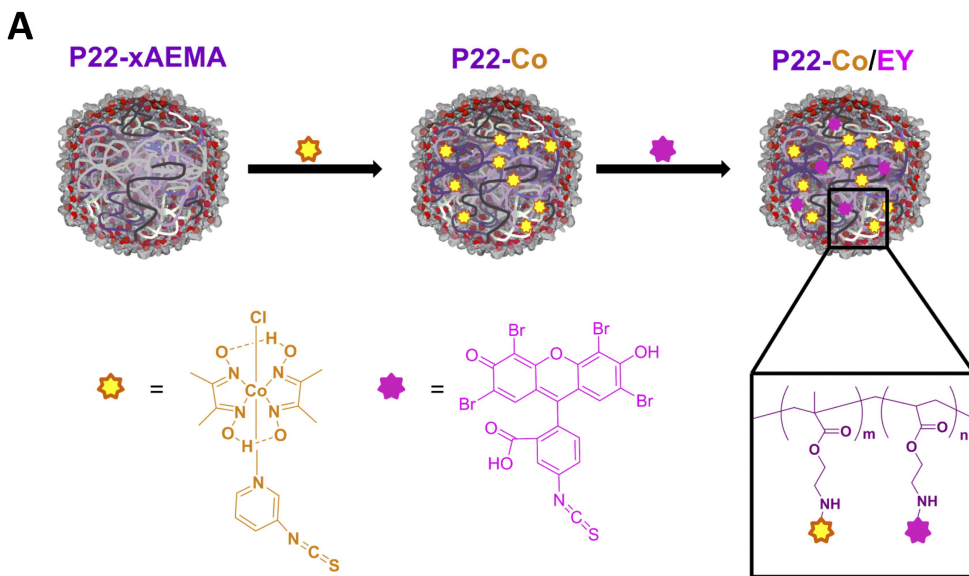

B

Sample	/AEMA	/AEMA
P22 _{0.25} Co/0.25xEY	0.25/1.00	0.25/1.00
P22 _{0.25} Co/0.50xEY	0.25/1.00	0.50/1.00
P22 _{0.25} Co/0.75xEY	0.25/1.00	0.75/1.00
P22 _{0.25} xEY/0.25xCo	0.25/1.00	0.25/1.00
P22 _{0.25} xEY/0.50xCo	0.50/1.00	0.25/1.00
P22 _{0.25} xEY/0.75xCo	0.75/1.00	0.25/1.00
P22 ₁ xCo/1xEY	1.00/1.00	1.00/1.00
P22 ₅ xCo/1xEY	5.00/1.00	1.00/1.00