



A Cu Peak

Control

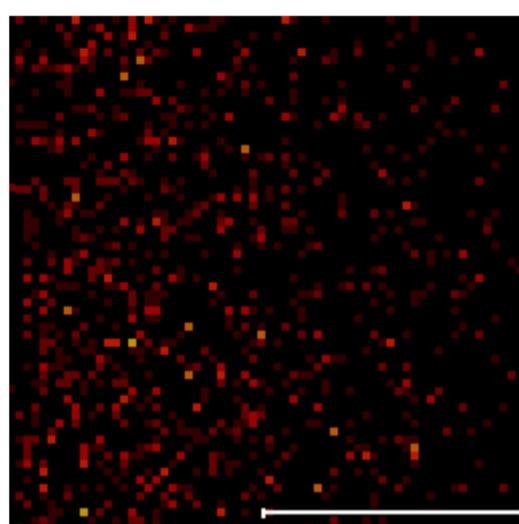


High


1 μ g/mL FN

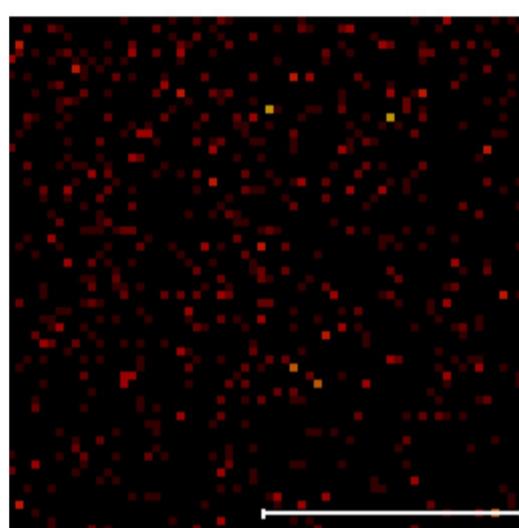

10 μ g/mL FN

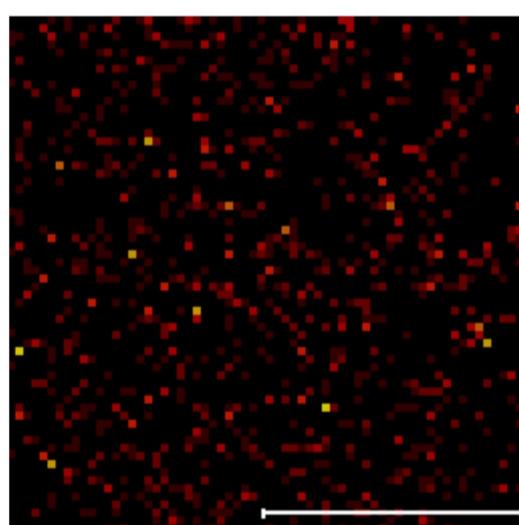


100 μ g/mL FN


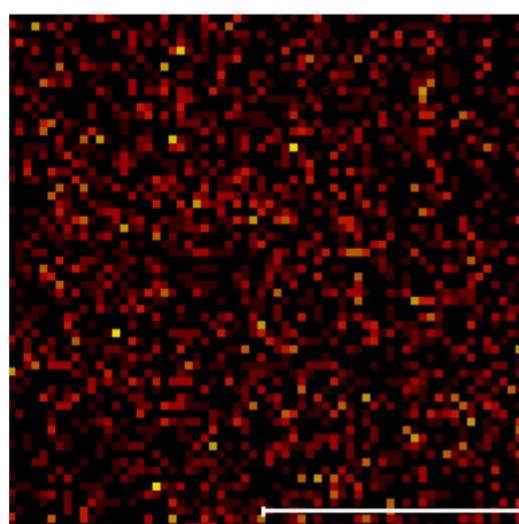


100 μ m


B

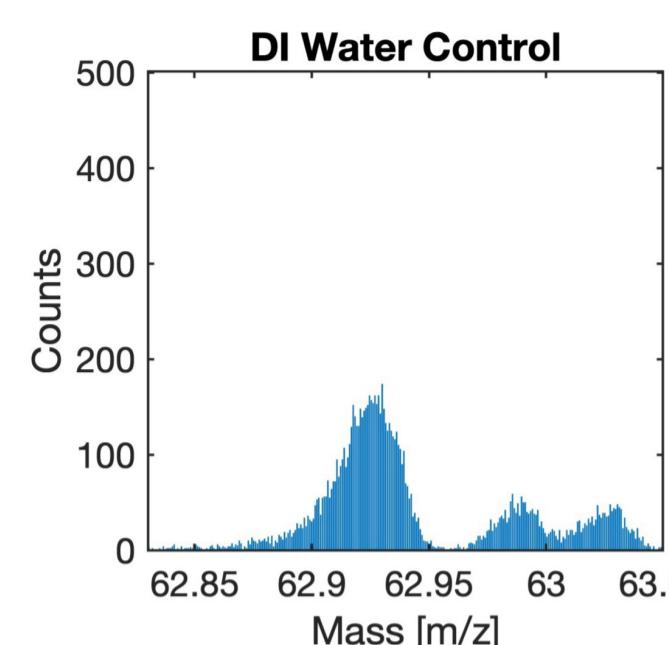

1 μ g mL^{-1} FN

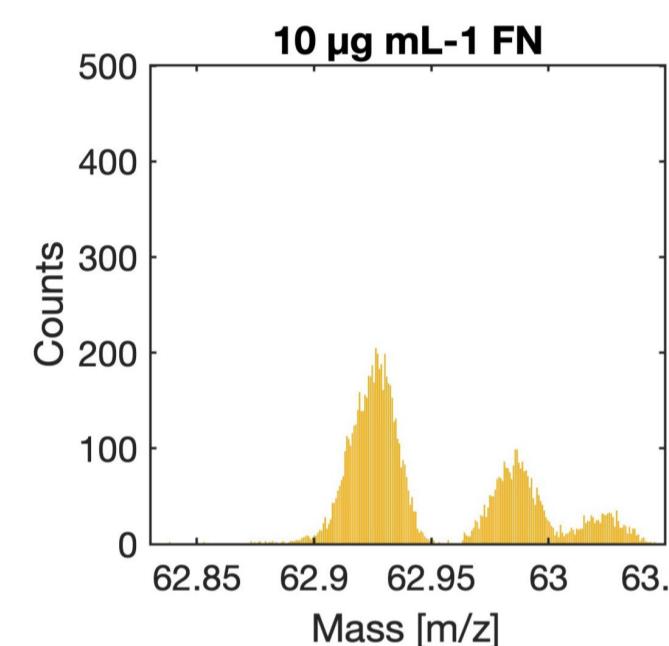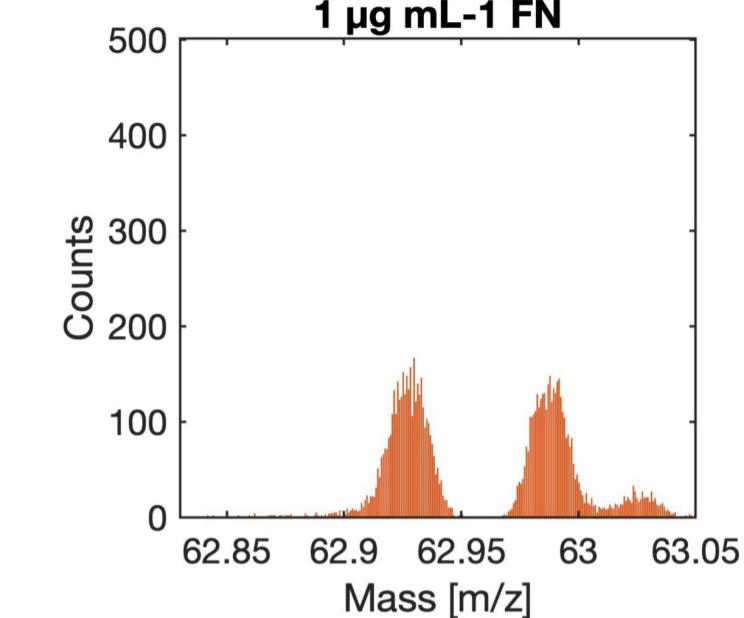

100 μ g mL^{-1} FN

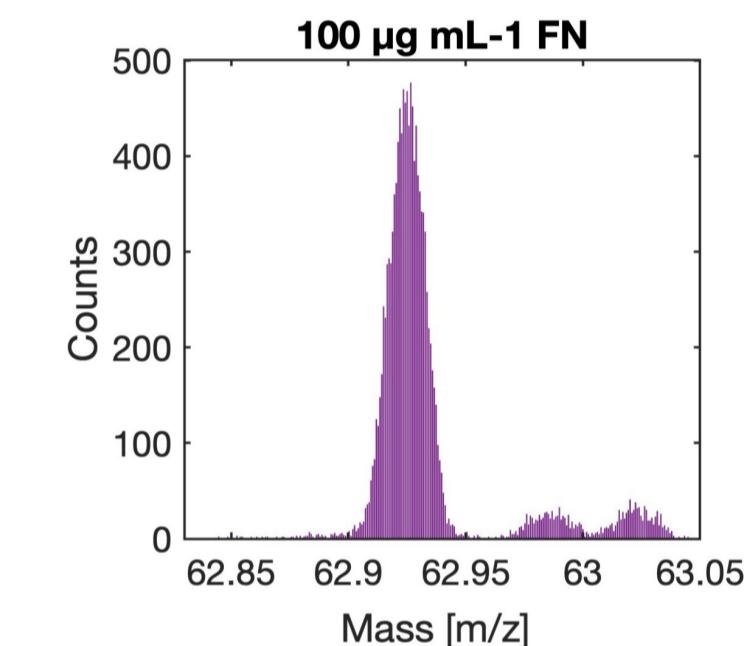

C

Normalized Cu peak value

FN concentration (μ g/mL)

Mean value
SD
Water control
Replicates

0.02
0.018
0.016
0.014
0.012
0.01