

Supplementary Material

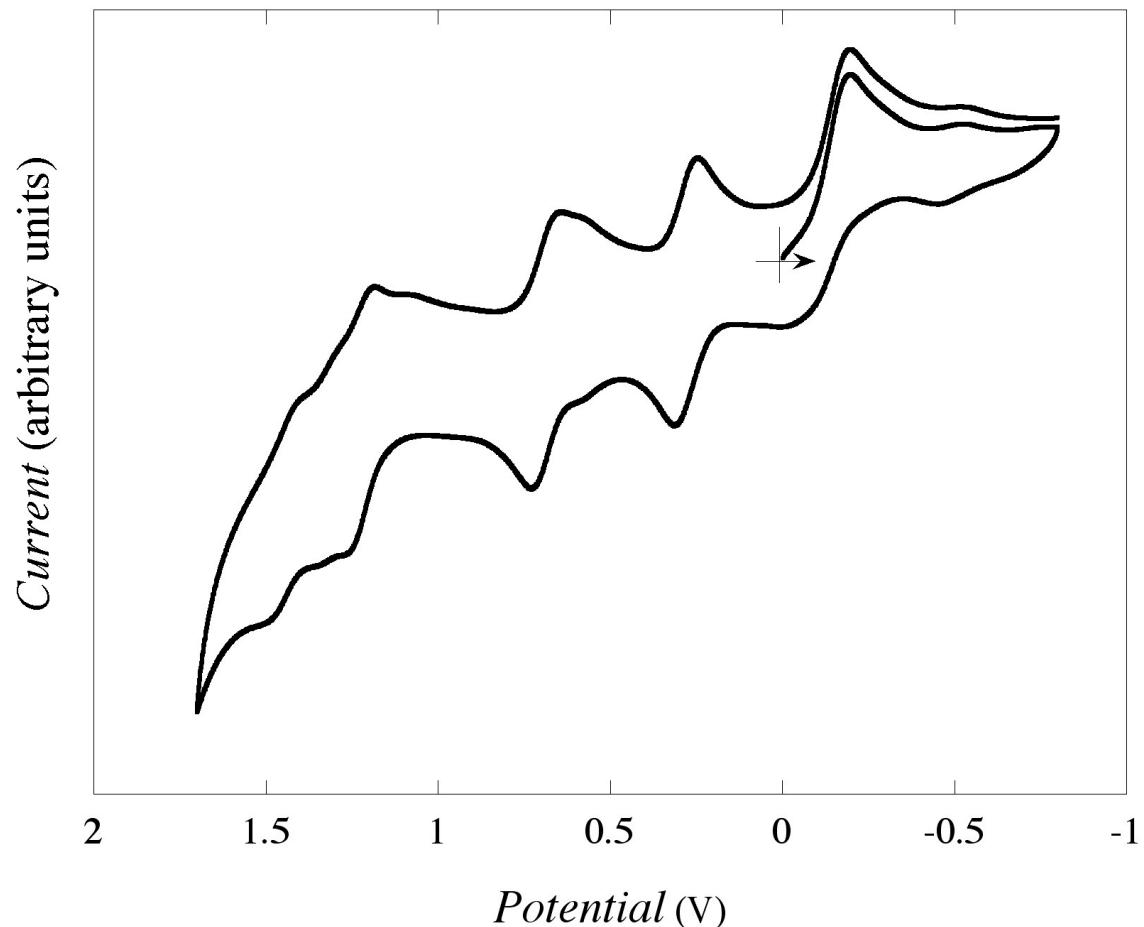


Figure S1. Cyclic voltammogram of **1** performed in 0.1 M [*n*-Bu₄N][PF₆] in CH₂Cl₂ versus standard Ag/AgCl reference electrode.

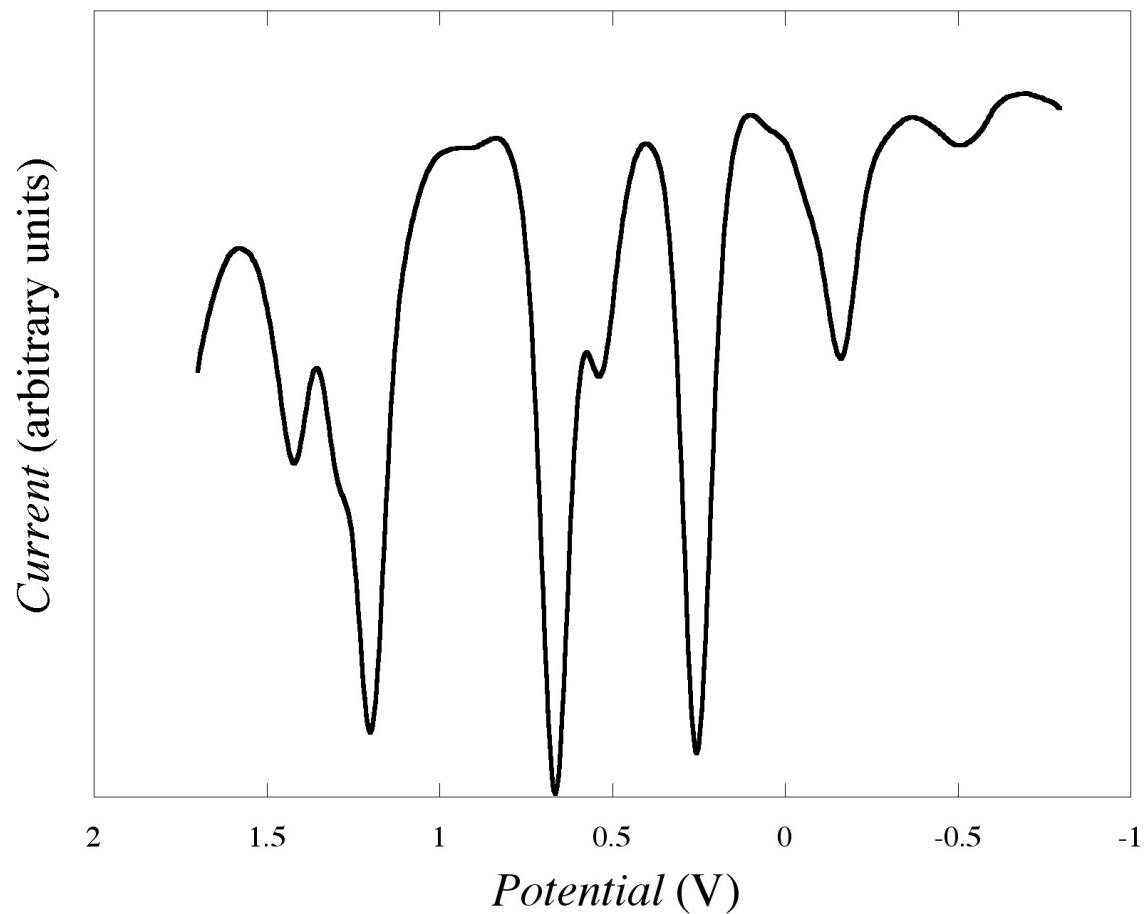


Figure S2. Differential pulse voltammogram of **1** performed in 0.1 M [*n*-Bu₄N][PF₆] in CH₂Cl₂ versus standard Ag/AgCl reference electrode.

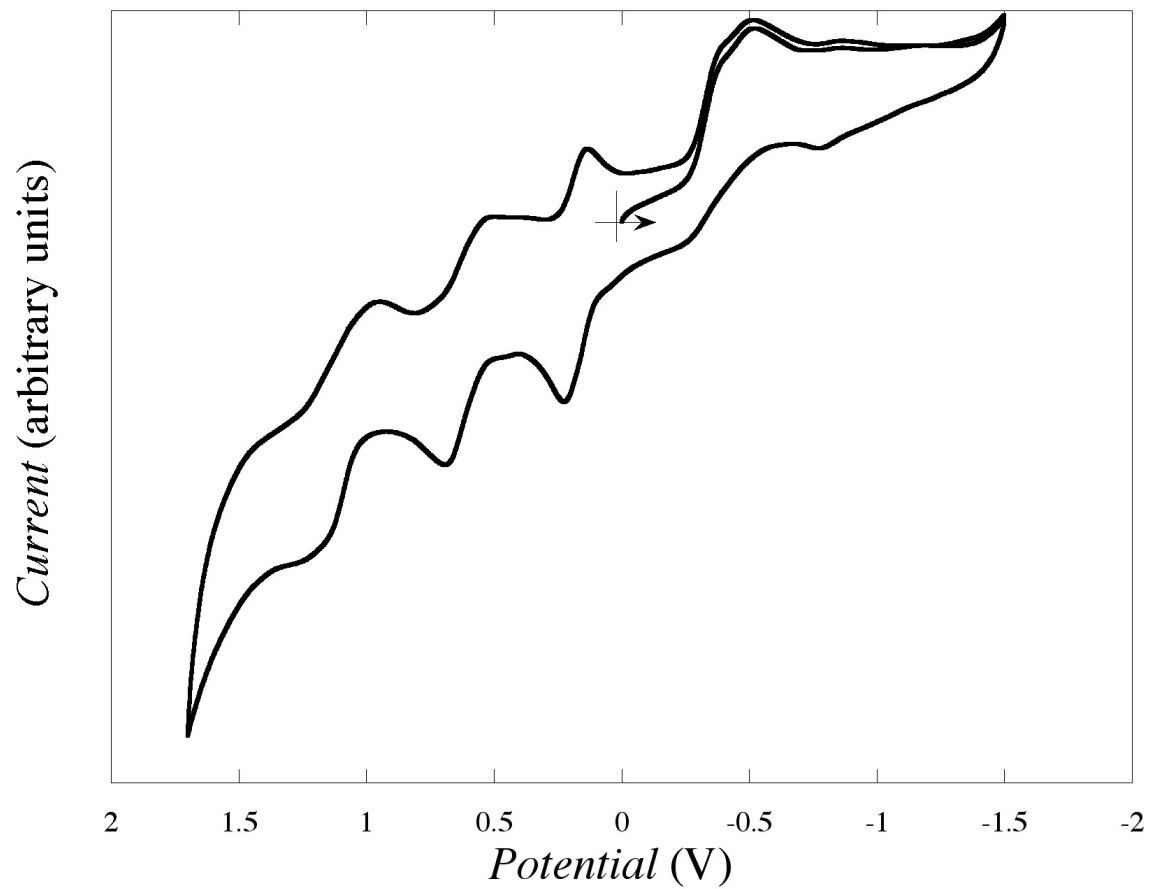


Figure S3. Cyclic voltammogram of **2** performed in 0.1 M $[n\text{-Bu}_4\text{N}][\text{PF}_6]$ in CH_2Cl_2 versus standard Ag/AgCl reference electrode.